


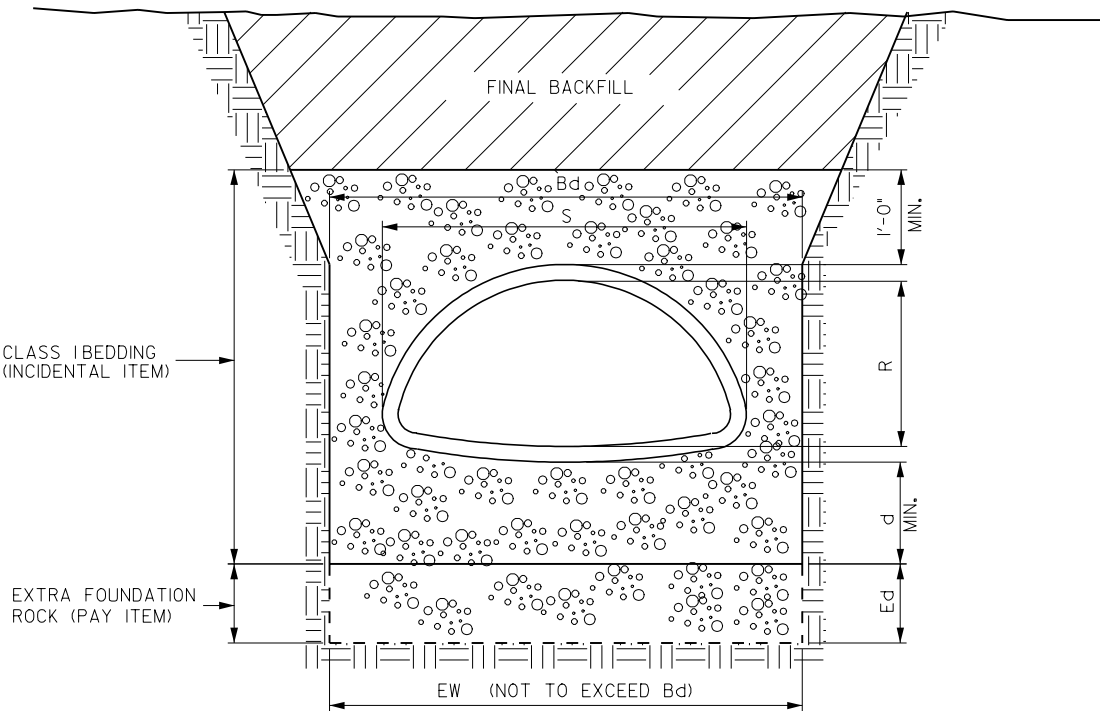

NOTES:

1. MAXIMUM TRENCH WIDTH AT TOP OF PIPE SHALL BE $1.25 \times S+1'$.
2. DEPTH OF BEDDING BELOW PIPE:

R	d MIN.
UNDER 45"	4"
OVER 45"	6"

3. EXTRA FOUNDATION ROCK: WHEN REQUIRED SHALL BE PLACED BELOW CLASS 1 BEDDING. MEASUREMENT SHALL BE MADE IN CUBIC FEET ($LENGTH \times Ed \times EW$) AND PAID AT THE UNIT PRICE BID.
4. FOR ROCK EXCAVATION THE TRENCH SHALL BE OVER EXCAVATED A MINIMUM OF 6" AND REFILLED WITH CLASS 1 BEDDING.

I	01/25/01	
REV.	DATE	BY
DATE:	01-01-98	

BEDDING FOR REINFORCED
CONCRETE ARCH PIPE

FIGURE: 3010.8

SHEET 1 OF 1