
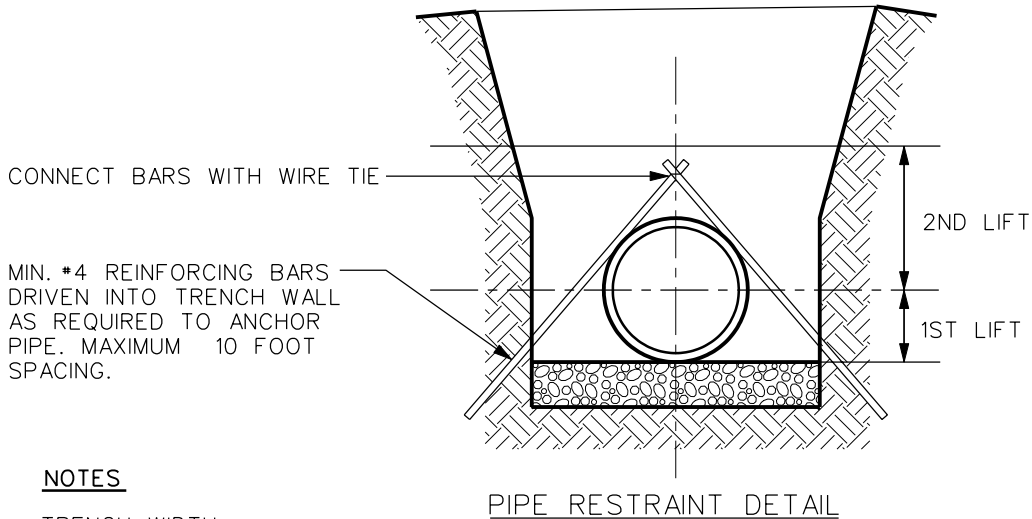


URBAN STANDARD SPECIFICATIONS for PUBLIC IMPROVEMENT MANUAL

NOTE:

SELECT SOILS UNDER PAVEMENT SLABS MAY BE SPECIFIED IN THE CONTRACT DOCUMENTS

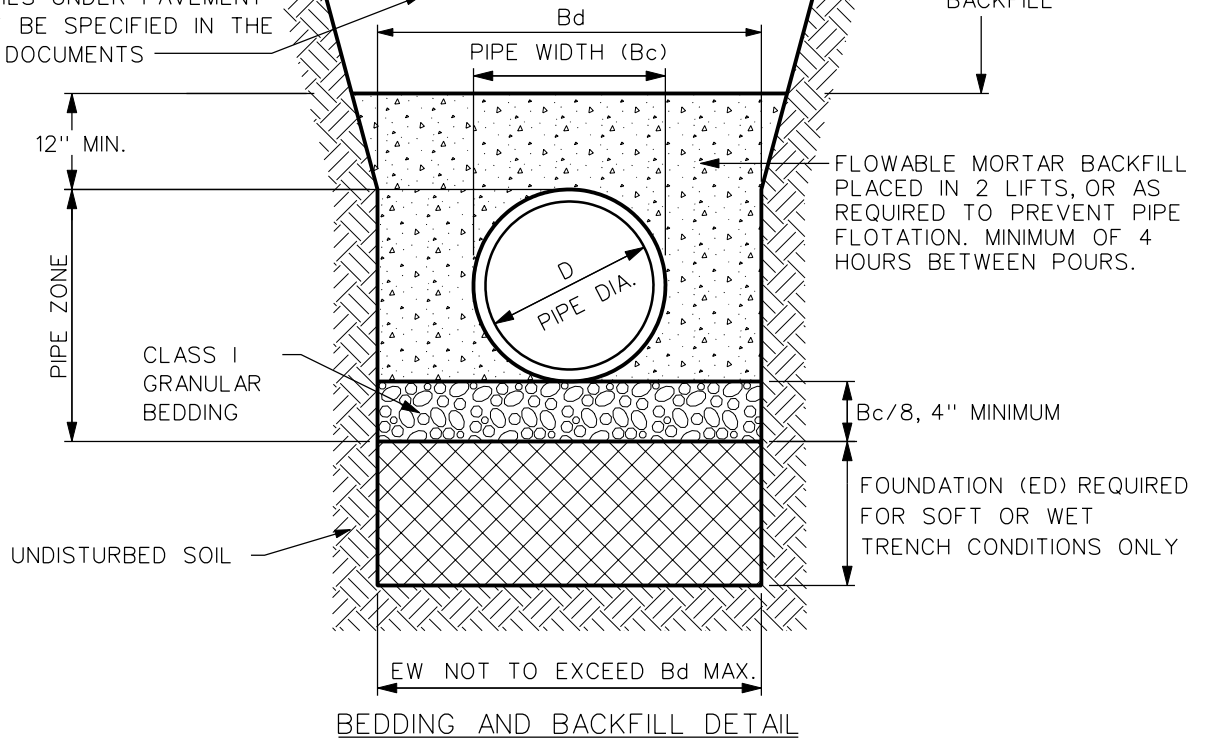

NOTES

TRENCH WIDTH:

RIGID PIPE

MIN.: $B_d = B_c + 1.5'$

MAX.: $B_d = 1.25B_c + 1'$ OR 54", WHICHEVER IS GREATER

FLEXIBLE & SEMI-RIGID

MIN.: $B_d = 1.25B_c + 1'$ OR $B_c + 1.5'$, WHICHEVER IS GREATER

MAX.: NO LIMIT

FLOWABLE MORTAR SHALL BE AS SPECIFIED IN SECTION 3010, 2.11.

REV.	DATE	BY	FLOWABLE MORTAR PIPE BACKFILL	FIGURE: 3010.9
DATE: 10-18-05				SHEET 1 OF 1