


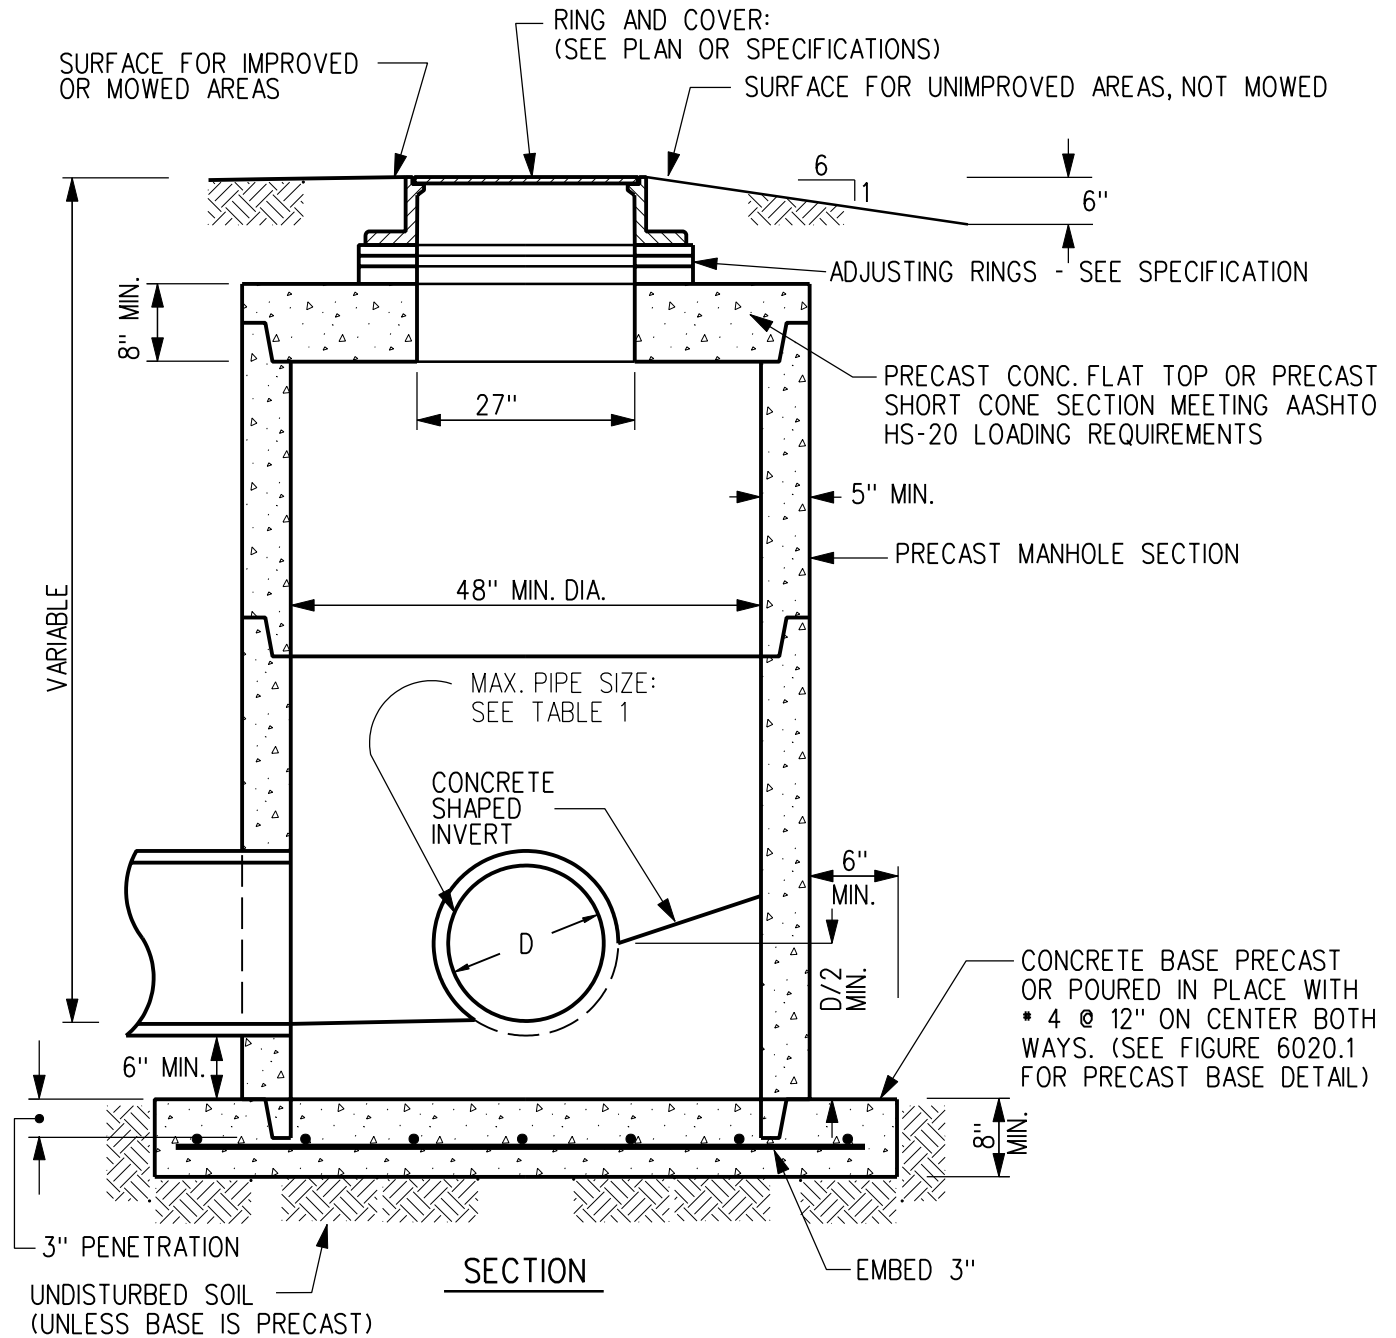

MANHOLE DIAMETER (INCHES)	MAXIMUM PIPE SIZE, (D), 2 PIPES*	
	AT 180° (INCHES)	AT 90° (INCHES)
48	24	18
60	36	24
72	42	30
84	48	36
96	60	42

* - FOR ADDITIONAL CONFIGURATIONS, A MINIMUM OF 12 INCHES OF CONCRETE SHALL REMAIN BETWEEN VERTICAL EDGES OF PIPE OPENINGS FOR CIRCULAR STRUCTURES. ADDITIONAL REINFORCEMENT WILL BE REQUIRED.

TABLE 1

2	10/19/04		TABLE 1	
REV.	DATE	BY	TYPE "M-A" MANHOLE (STORM SEWER)	FIGURE: 6020.12
DATE: 01-01-98				SHEET 1 OF 1