


URBAN STANDARD SPECIFICATIONS for PUBLIC IMPROVEMENT MANUAL

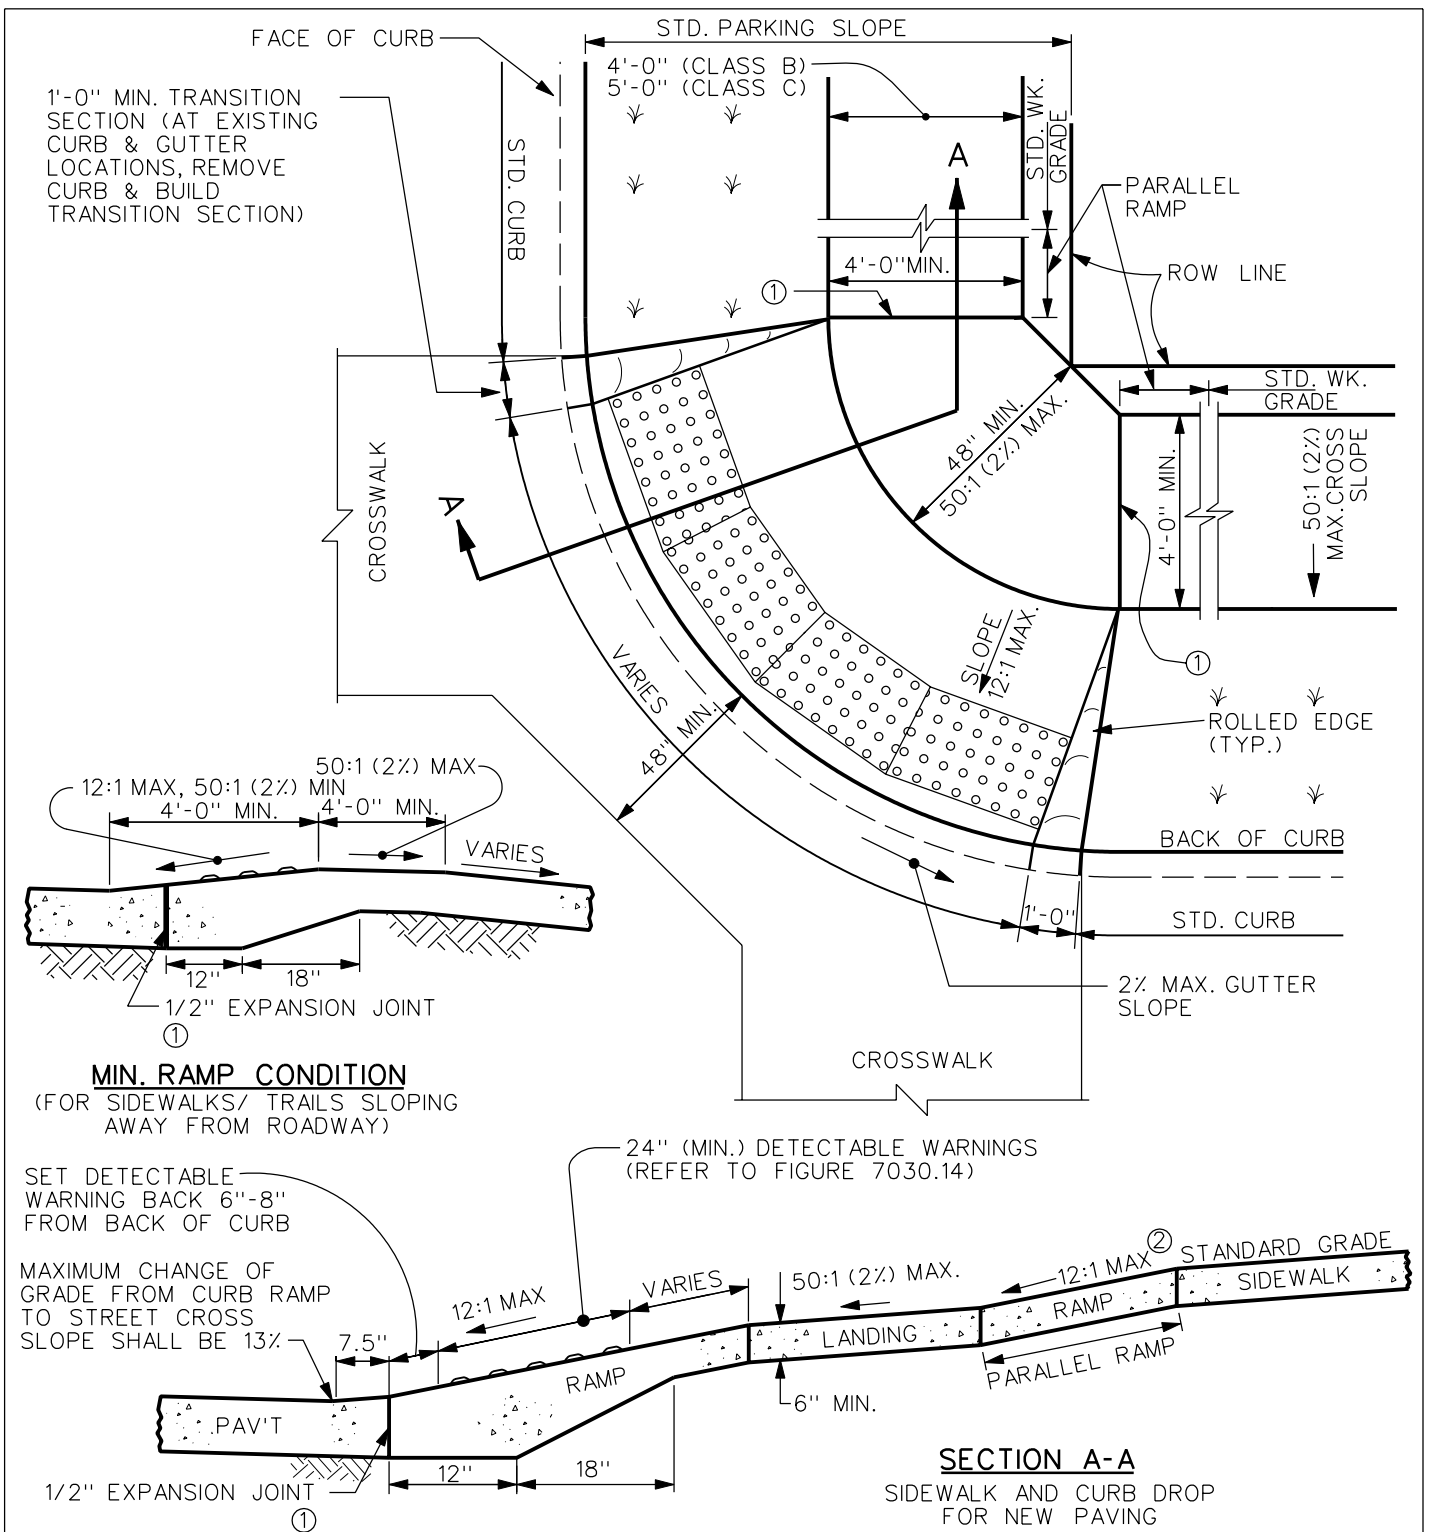

NOTES:

- ① PROVIDE A 1/2" EXPANSION JOINT AT THE BACK OF CURB. WHEN SPECIFIED, PROVIDE A KT-2 OR BT-3 JOINT BETWEEN THE SIDEWALK RAMP AND STREET PAVEMENT AND PLACE A 1/2" EXPANSION JOINT ON BOTH SIDES OF THE LANDING.
- ② THE LENGTH OF THE PARALLEL RAMP SHALL NOT BE REQUIRED TO EXCEED 15'-0", REGARDLESS OF THE RESULTING SLOPE.

3	10/18/05			
REV.	DATE	BY	OPTIONAL RAMP (ALTERNATE 2) WITHIN INTERSECTION RADIUS FOR CLASS "B" OR "C" SIDEWALK	FIGURE: 7030.13B
DATE: 01-01-98				SHEET 1 OF 1