

1 Perforated Subdrain (Polyethylene Corrugated Tubing).

If corrugated metal pipe is used, an outlet 2 inches larger than existing subdrain pipe is required. If double-walled PE

as the existing subdrain pipe may be used.

(3) The pipes should be coupled in one of the two following

4 If a concrete headwall is used, refer to DR-306.

diameter, use Special Outlet, Type C.

(5) For existing subdrain pipes larger than 12 inches in

opening with grout.


or PVC pipe is used, an outlet pipe of the same diameter

ways: (1) Use an inside fit reducer coupler (coupler must

(2) Insert 12 inches of the existing subdrain pipe into the

be inserted a minimum of 12 inches into C.M.P.); or

corrugated metal outlet pipe, then fully seal the entire

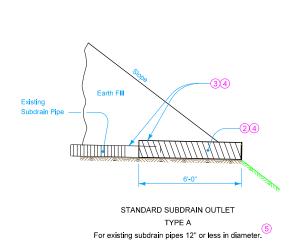


Possible Ditch Bottom

2'-0" Radius Minimum

2'-0" Radius Minimum

PRESSURE RELEASE OUTLET
TYPE B

- Possible Contract Item: Subdrain Outlet (DR-305)
- Possible Tabulation: 104-5C

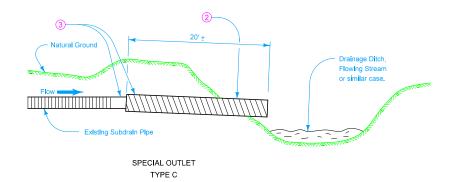



SUBDRAIN OUTLETS (STANDARD SUBDRAIN, PRESSURE RELEASE AND SPECIAL)