


LEFT SIDE

- ① FAN THERMOSTAT
- ② THIS IS THE SPACE THE TERMINATION ENCLOSURE WILL OCCUPY ON THE LEFT SIDE OF THE CABINET

	REVISION
	New 04-18-2023
STANDARD ITS PLAN	ITS-302
	SHEET 1 of 3
REVISIONS: New.	
<small>APPROVED BY STATE ITS ENGINEER</small>	

ITS CABINET LAYOUT

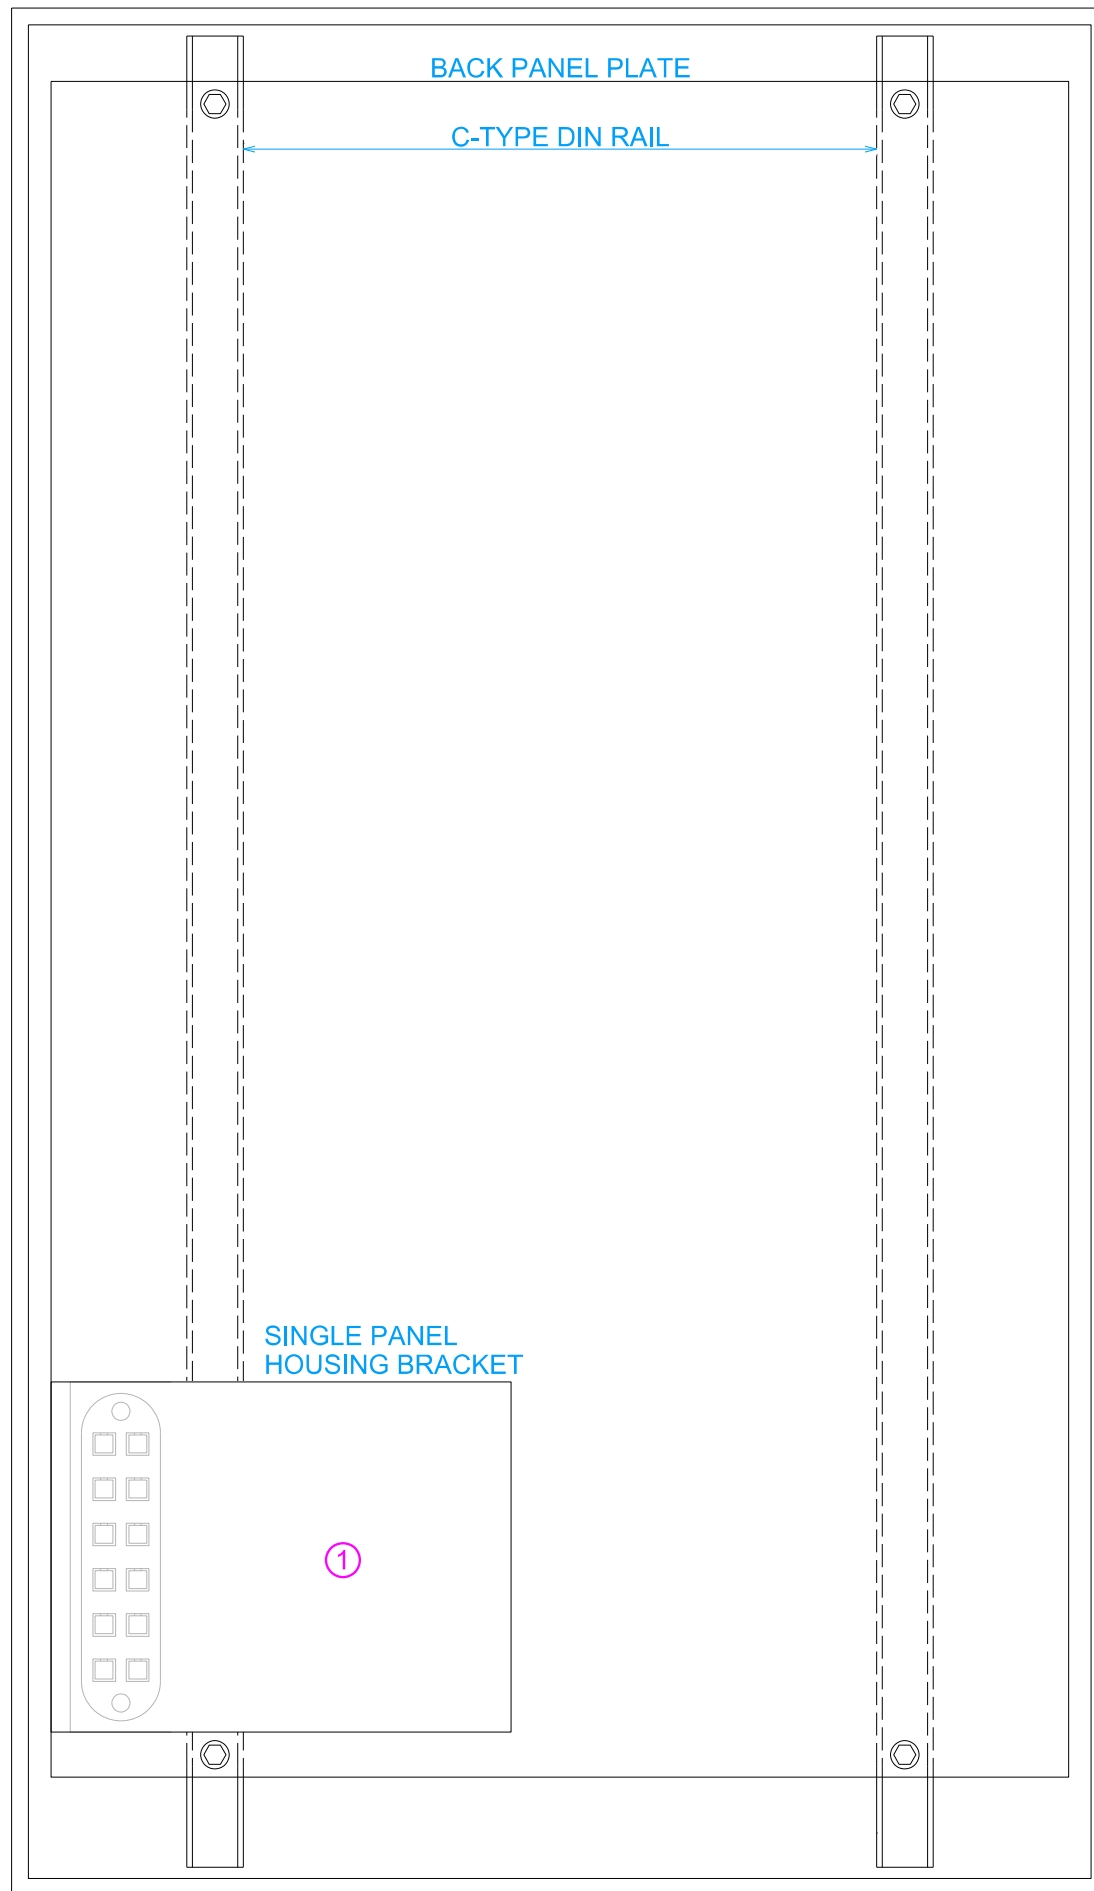


① TERMINATION ENCLOSURE DOOR

	REVISION	
	New	04-18-2023
STANDARD ITS PLAN		ITS-302
		SHEET 2 of 3

REVISIONS: New.

Mark Van Dyke
 APPROVED BY STATE ITS ENGINEER

ITS CABINET LAYOUT

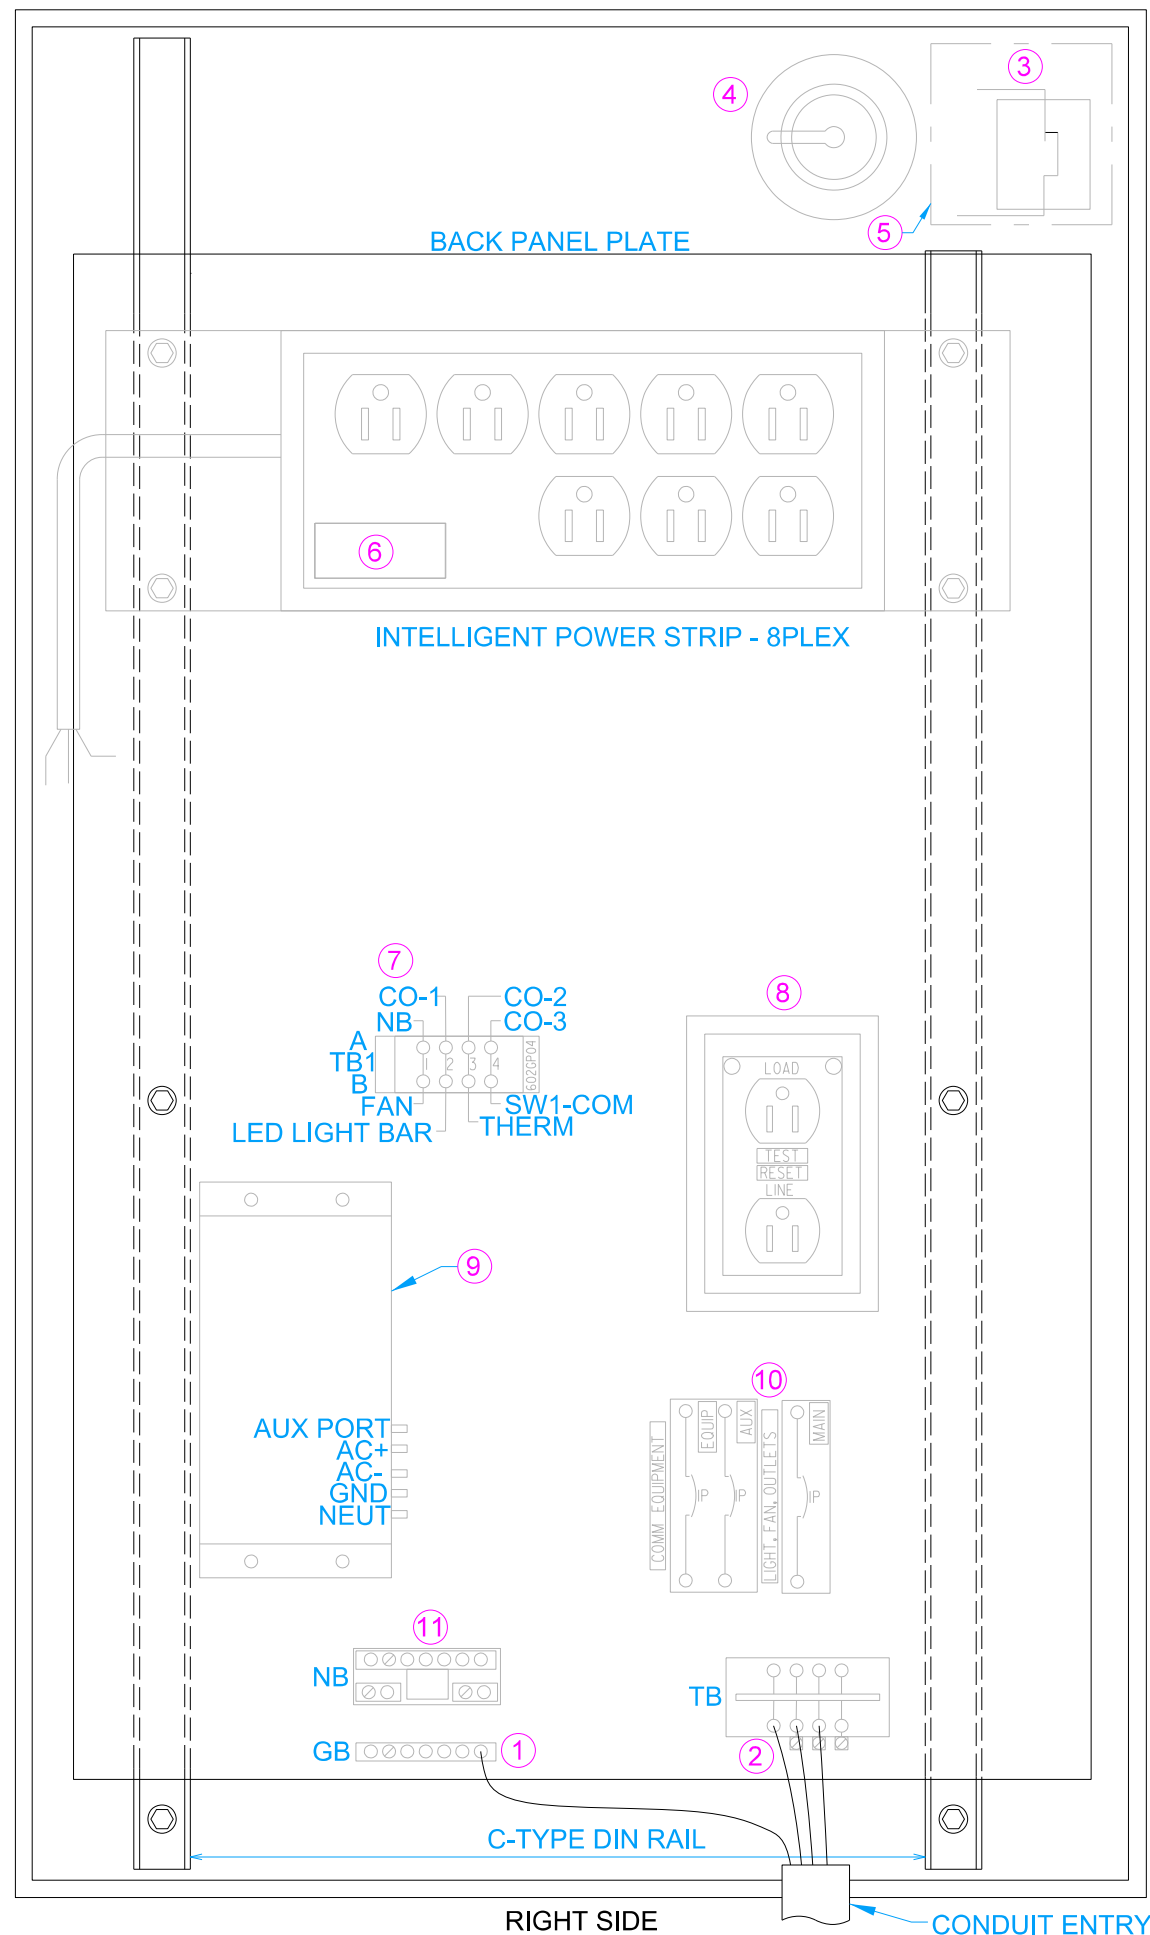

- ① TERMINATE TRACER WIRE ON GROUND BAR
- ② TERMINATE HOT, NEUTRAL, AND GROUND AT POWER TERMINAL BAR
- ③ SW1 DOORSWITCH
- ④ LED LIGHT BAR
- ⑤ SWITCH BRACKET
- ⑥ FOR COMMUNICATION EQUIPMENT
- ⑦ TERMINAL BLOCK
- ⑧ CONVENIENCE OUTLETS - 15A GFCI
- ⑨ PARALLEL SURGE PROTECTOR
- ⑩ POWER PANEL CIRCUIT BREAKERS
- ⑪ NEUTRAL BAR

	REVISION
	New 04-18-2023
STANDARD ITS PLAN	ITS-302
REVISIONS: New.	SHEET 3 of 3
 APPROVED BY STATE ITS ENGINEER	

ITS CABINET LAYOUT